


- NOTES:
1. MECHANICAL JOINT SLEEVES REQUIRED FOR SIZE-ON-SIZE TAPS. ALL OTHER TAPS SHALL USE STAINLESS STEEL SLEEVES.
  2. SEE CHART FOR APPROVED TAPPING SLEEVES.
  3. INSTALLATION TO INCLUDE TEST PLUG.
  4. FLANGE MAY BE DUCTILE IRON INSTEAD OF STAINLESS.
  5. PRIOR TO TAPPING THE LINE, PROVIDE A HYDROSTATIC TEST ON THE SLEEVE PER YORK COUNTY SPECIFICATIONS.

MECHANICAL JOINT	STAINLESS STEEL
Clow – F5205 M & H – Style 974/1174/1274 Mueller – H615	Ford – FAST Rockwell – 663 Smith Blair – 663 Power Seal – 3490AS

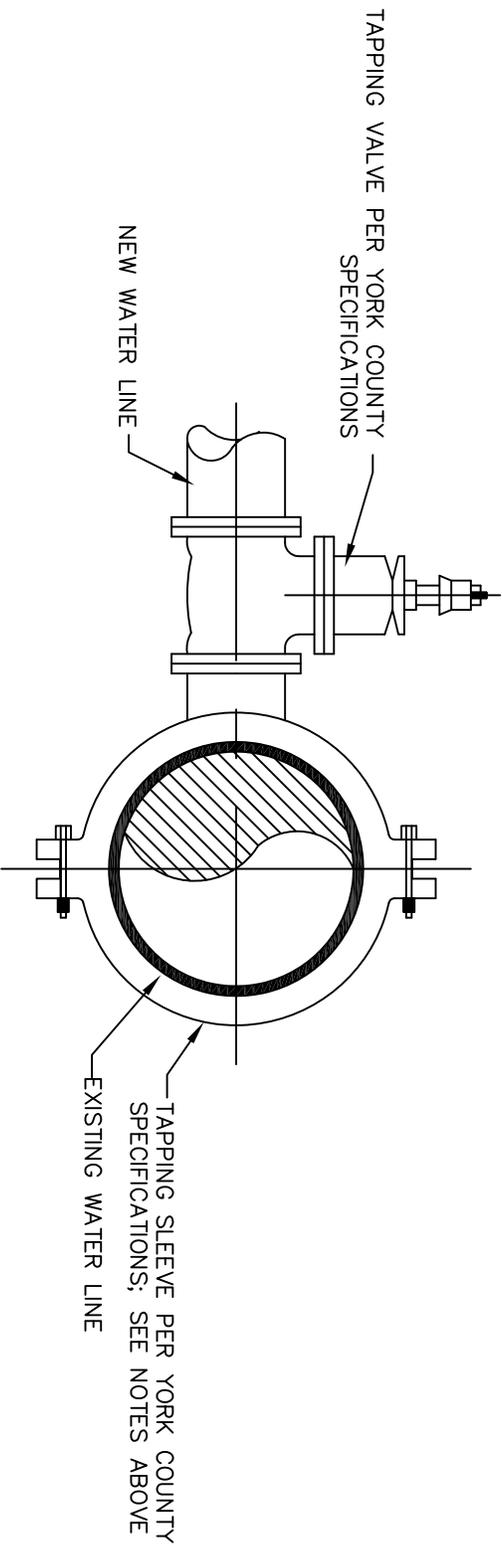

ELEVATION  
N.T.S.

REVISIONS

NO.	DATE	DESCRIPTION
1	12/13	MATERIAL CHANGE

**YORK COUNTY  
ENGINEERING  
STANDARDS**

**WATER TAPPING SLEEVE AND VALVE  
STANDARD DETAIL**

STD. NO.
11.07
DATE
09/06