


NOTES:

1. CONTRACTOR MAY SUBSTITUTE CONCRETE RESTRAINT BLOCKING AT THE HYDRANT ELBOW WITH MECHANICAL JOINT RESTRAINTS (MEGALUG SERIES 1100). A BLOCK MUST BE INSTALLED TO SUPPORT THE ELBOW.
2. ALL FIRE HYDRANTS AND ASSEMBLIES EXPOSED TO VIEW SHALL BE PAINTED WITH 2 OR MORE COATS OF WHITE HYDRANT ENAMEL PAINT.
3. FIRE HYDRANT OPERATING NUT AND ALL VALVES SHALL BE LEFT-HAND OPEN.
4. PIPING FROM MAIN TO HYDRANT ASSEMBLY TO BE DUCTILE IRON.

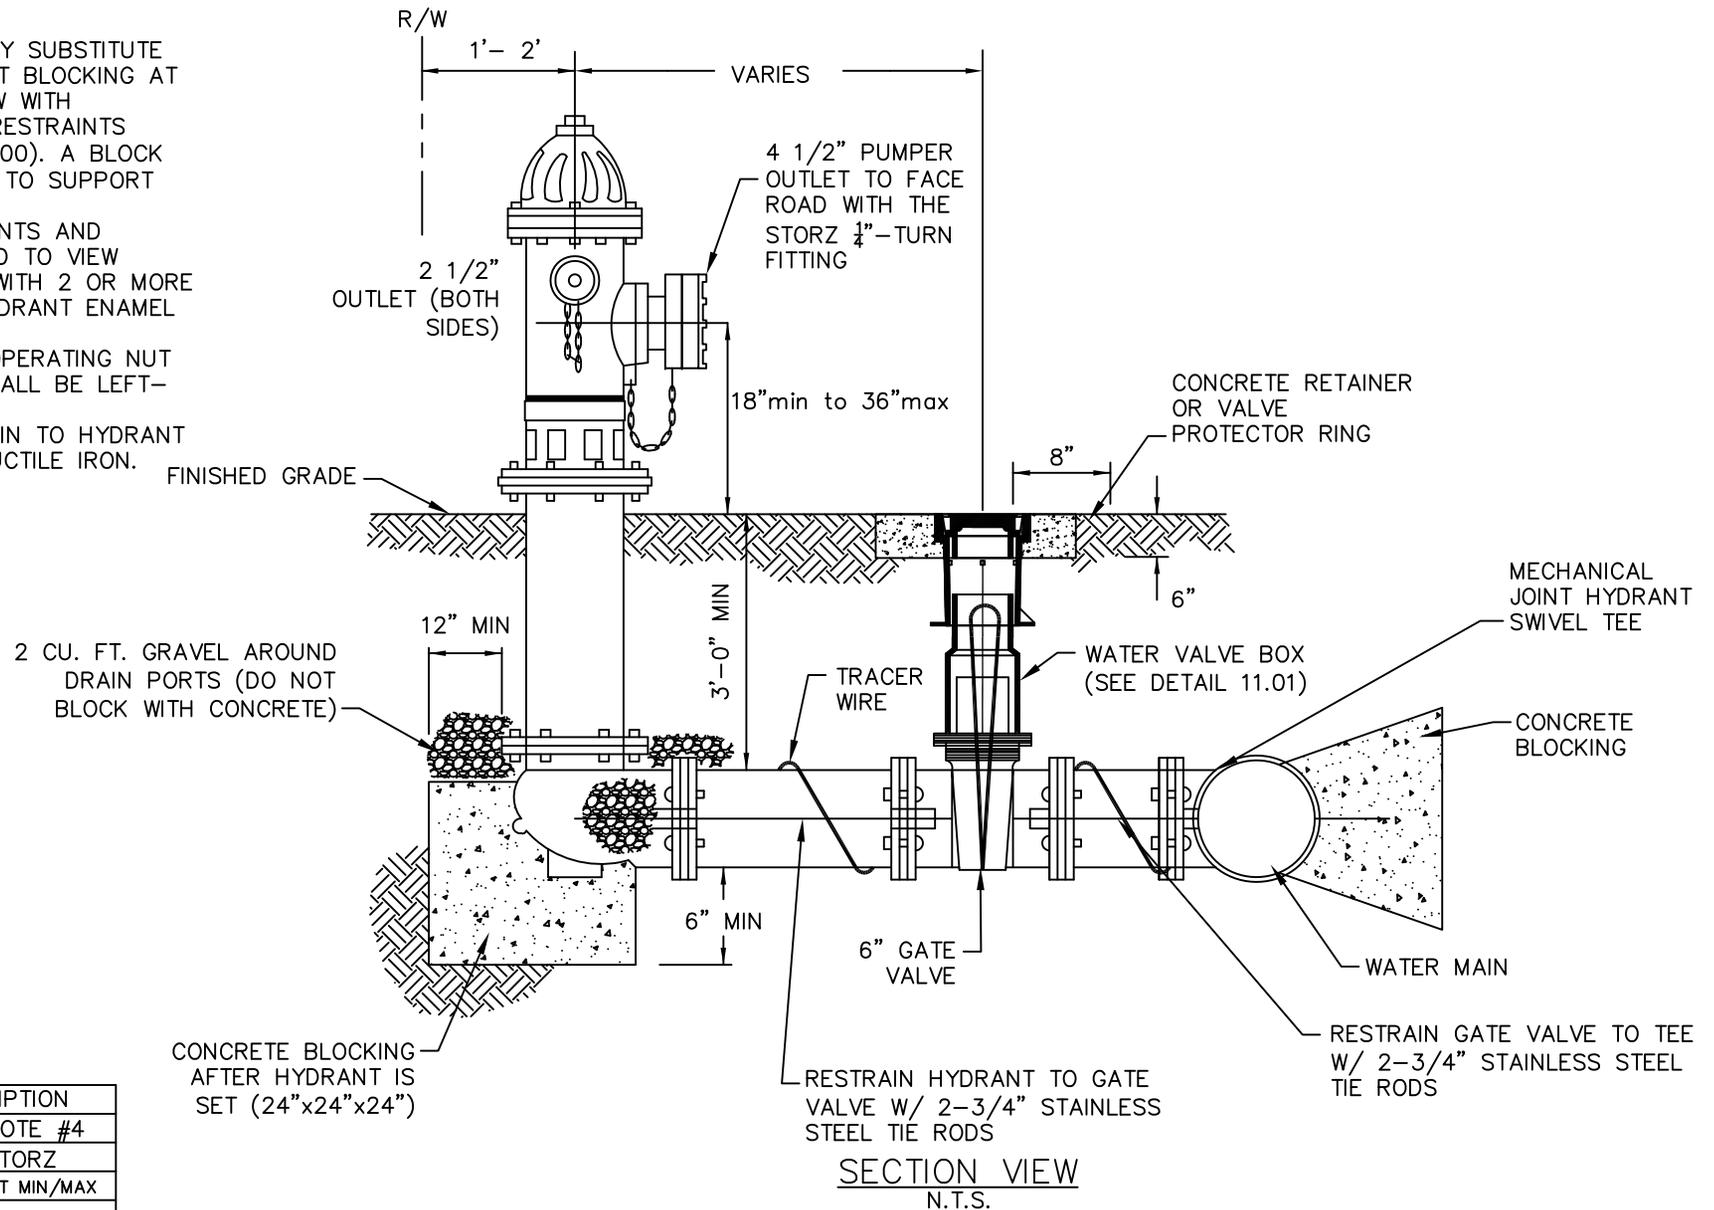

REVISIONS		
NO.	DATE	DESCRIPTION
1	3/09	ADDED NOTE #4
2	8/10	ADDED STORZ
3	10/14	PUMPER OUTLET MIN/MAX

**YORK COUNTY
ENGINEERING
STANDARDS**

**FIRE HYDRANT
STANDARD DETAIL**

STD. NO.	11.09
DATE	09/06