


- NOTES
1. REDUCED PRESSURE PRINCIPLE ASSEMBLIES (RP) MUST BE ON THE SCDHEC LIST OF APPROVED BACKFLOW PREVENTION ASSEMBLIES FOR SOUTH CAROLINA.
  2. 3/4"-2" RP INCLUDES SHUT OFF VALVES #1 AND #2 AS PART OF THE ASSEMBLY. NO SUBSTITUTIONS SHALL BE PERMITTED.
  3. IF OUTDOOR INSTALLATION HAS PROTECTIVE COVERING, IT SHALL BE AS SPECIFIED IN SCDHEC SPECIFICATIONS FOR INSTALLATION OF BACKFLOW PREVENTION ASSEMBLIES.
  4. TEST COCK #1 SHALL BE UPSTREAM OF SHUT OFF VALVE #1 AND IS PART OF THE ASSEMBLY.
  5. ABOVE GROUND INSTALLATIONS MUST BE LOCATED BEYOND PROPERTY LINE OR ROAD R/W.
  6. ALL TESTING MUST BE DONE BY A STATE CERTIFIED BACKFLOW PREVENTION TESTER.
  7. INITIAL BACKFLOW DEVICE TEST REPORT MUST BE SUBMITTED TO YORK COUNTY PRIOR TO METER ACTIVATION.

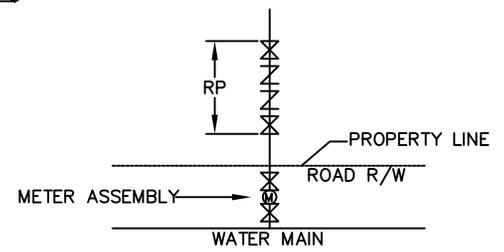

REVISIONS		
NO.	DATE	DESCRIPTION

YORK COUNTY ENGINEERING STANDARDS

REDUCE PRESSURE PRINCIPLE ASSEMBLY  
3/4" - 2"

STD. NO.
11.28
DATE
03/15