


NOTES:

1. ANCHOR BOLTS AND STRAPS SHALL BE GALVANIZED AND HOT ASPHALT DIPPED.
2. GALVANIZED STEEL OR IRON CAN BE USED.
3. FOR PIPES 24" AND LARGER USE 1" DIA. BOLTS AND 1-1/16" ϕ HOLE IN STRAP.
4. HOLES TO BE DRILLED IN STRAP.
5. PROVIDE WASHERS UNDER STRAP SUCH THAT STRAP IS PULLED DOWN TIGHT.

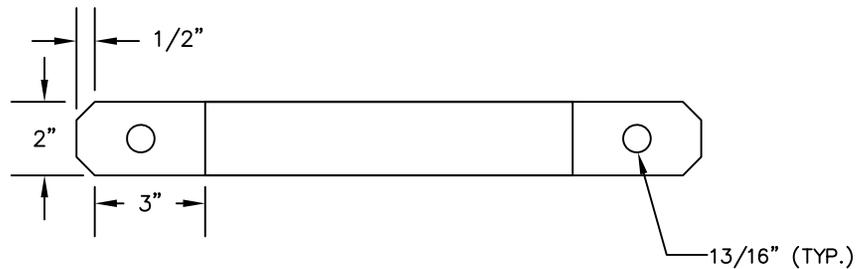

| REVISIONS | | |
|-----------|------|-------------|
| NO. | DATE | DESCRIPTION |
| | | |
| | | |

**YORK COUNTY
ENGINEERING
STANDARDS**

**PIER STRAP
24" PIPE & SMALLER**

| |
|----------|
| STD. NO. |
| 15.12 |
| DATE |
| 08/07 |