


- NOTES:**
- DDCVA'S MUST CONFORM TO STATE & LOCAL SPECIFICATIONS.
  - APPROVED DDCVA INCLUDES SHUT-OFF VALVES #1 AND #2 AS PART OF THE UNIT. NO SUBSTITUTIONS SHALL BE PERMITTED. 6" CLEARANCE SHALL BE WITH VALVE OPEN.
  - FIRE LINE INSTALLATIONS SHALL HAVE OUTSIDE STEM AND YOKE (OS&Y) HANDWHEEL OPERATORS.
  - VAULT, DOORS, OR COVERS AND SUPPORT ASSEMBLY SHALL BE DESIGNED BY OWNER AS REQUIRED.
  - TEST COCK #1 SHALL BE UPSTREAM OF SHUT-OFF VALVE #1 AND IS PART OF ASSEMBLY.
  - IF DRAINAGE CANNOT BE PROVIDED TO FREE ATMOSPHERE OR STORM DRAINAGE, THE DDCVA SHALL BE INSTALLED ABOVE GROUND.
  - DRAINAGE MAY BE PROVIDED AS SHOWN OR AS FLOOR DRAIN.


NO.	DATE	DESCRIPTION

REVISIONS

YORK COUNTY ENGINEERING  
STANDARDS

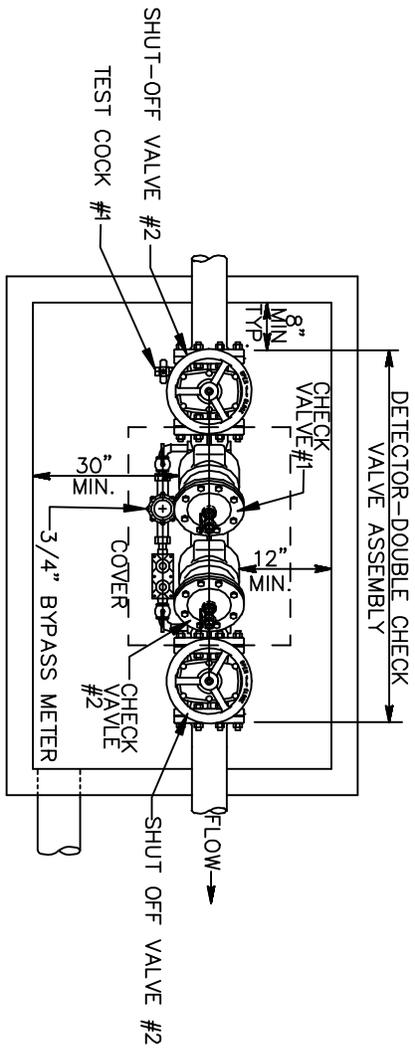

PLAN VIEW  
N.T.S.

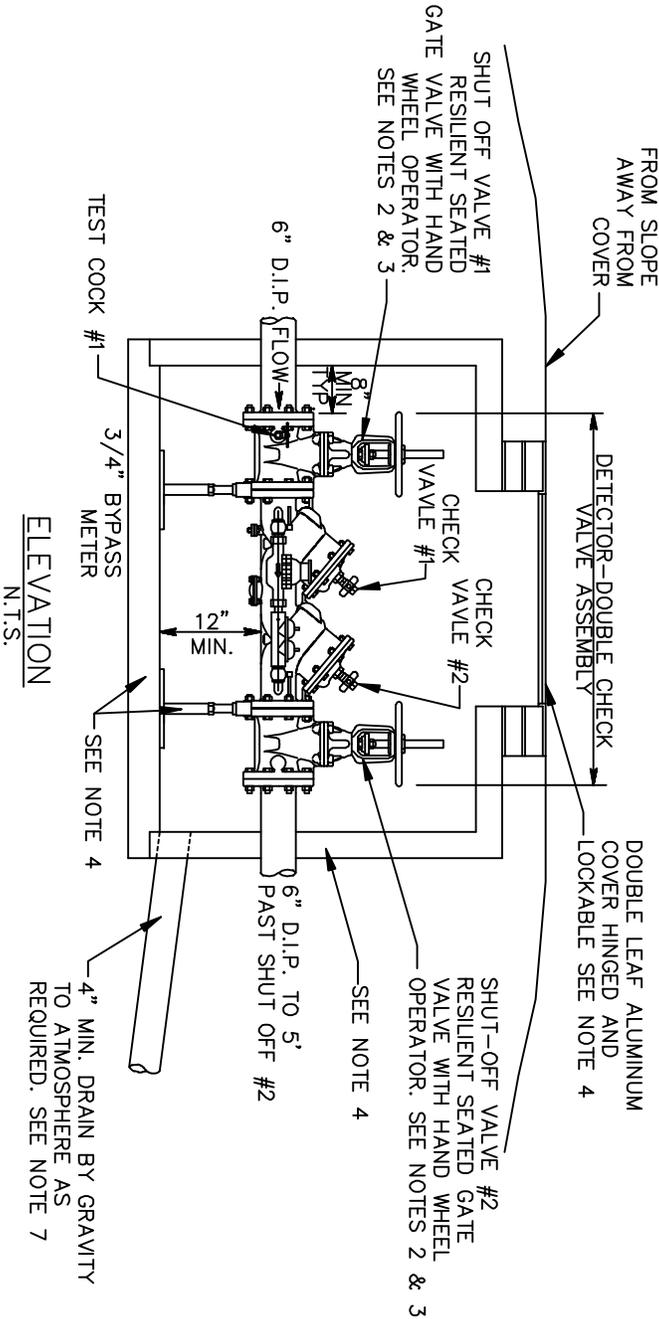

ELEVATION  
N.T.S.

DOUBLE-DETECTOR CHECK VALVE ASSEMBLY  
STANDARD DETAIL

STD. NO.	11.04
DATE	09/06