
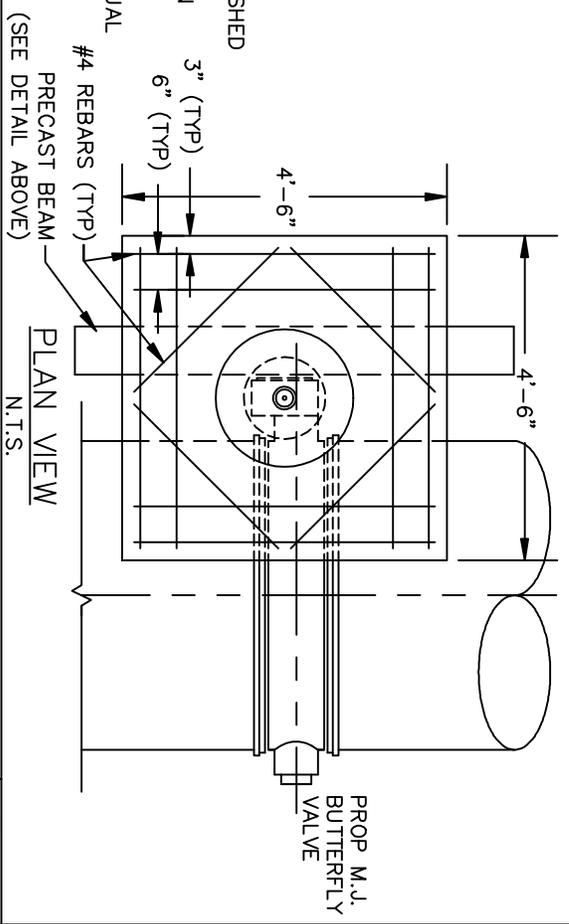


- NOTES:**
- METHOD B SHALL BE STANDARD UNLESS METHOD A IS SPECIFIED ON PLANS
 - DIAMETER OF RISER MAY VARY AS REQUIRED BY VALVE ACTUATOR.
 - WHEN OPERATING NUT DEPTH EXCEEDS 4'-0" BELOW FINISHED GRADE, PROVIDE EXTENSION STEM WITH STD. 2" SQUARE OPERATING NUT IN TOP SECTION OF VALVE BOX. EXTENSION STEM SHALL BE SIZED AS RECOMMENDED BY THE VALVE MANUFACTURER.
 - EACH BUTTERFLY VALVE SHALL BE FURNISHED WITH MANUAL OPERATOR EQUIPPED WITH A 2" SQUARE OPERATING NUT.
 - THE OPERATOR SHALL OPEN THE VALVE WHEN THE OPERATING NUT IS TURNED TO THE LEFT OR COUNTER-CLOCKWISE.

REVISIONS

NO.	DATE	DESCRIPTION

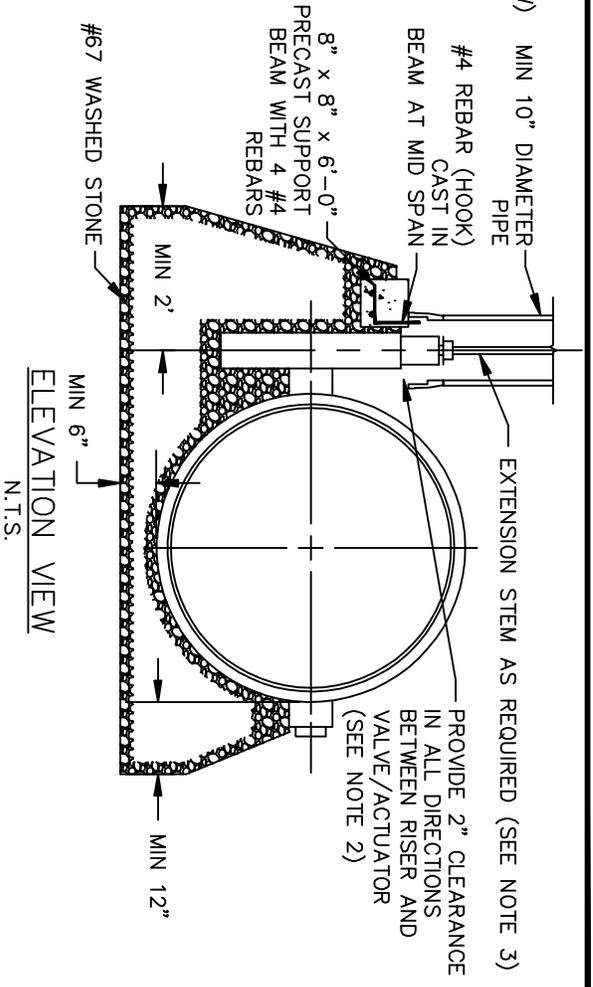

PROP M.J. BUTTERFLY VALVE

YORK COUNTY ENGINEERING STANDARDS

BUTTERFLY VALVE DIRECT BURY INSTALLATION

STD. NO.	11.05
DATE	09/06