


- NOTES:
1. AIR RELEASE VALVE TO BE APCCO MODEL 200A, CRISPIN TYPE "N" MODEL #PIO (1/4" ORIFICE, 0 TO 150 PSI WORKING PRESSURE, 1" NPT CONNECTION), OR APPROVED EQUAL.
 2. APPROXIMATE LOCATION OF AIR RELEASE VALVES SHOWN ON PLAN AND PROFILE SHEETS. FIELD ADJUST LOCATION TO MATCH HIGH POINT.
 3. AIR RELEASE VALVE TO BE SIZED PER MANUFACTURERS RECOMMENDATIONS.

REVISIONS

NO.	DATE	DESCRIPTION

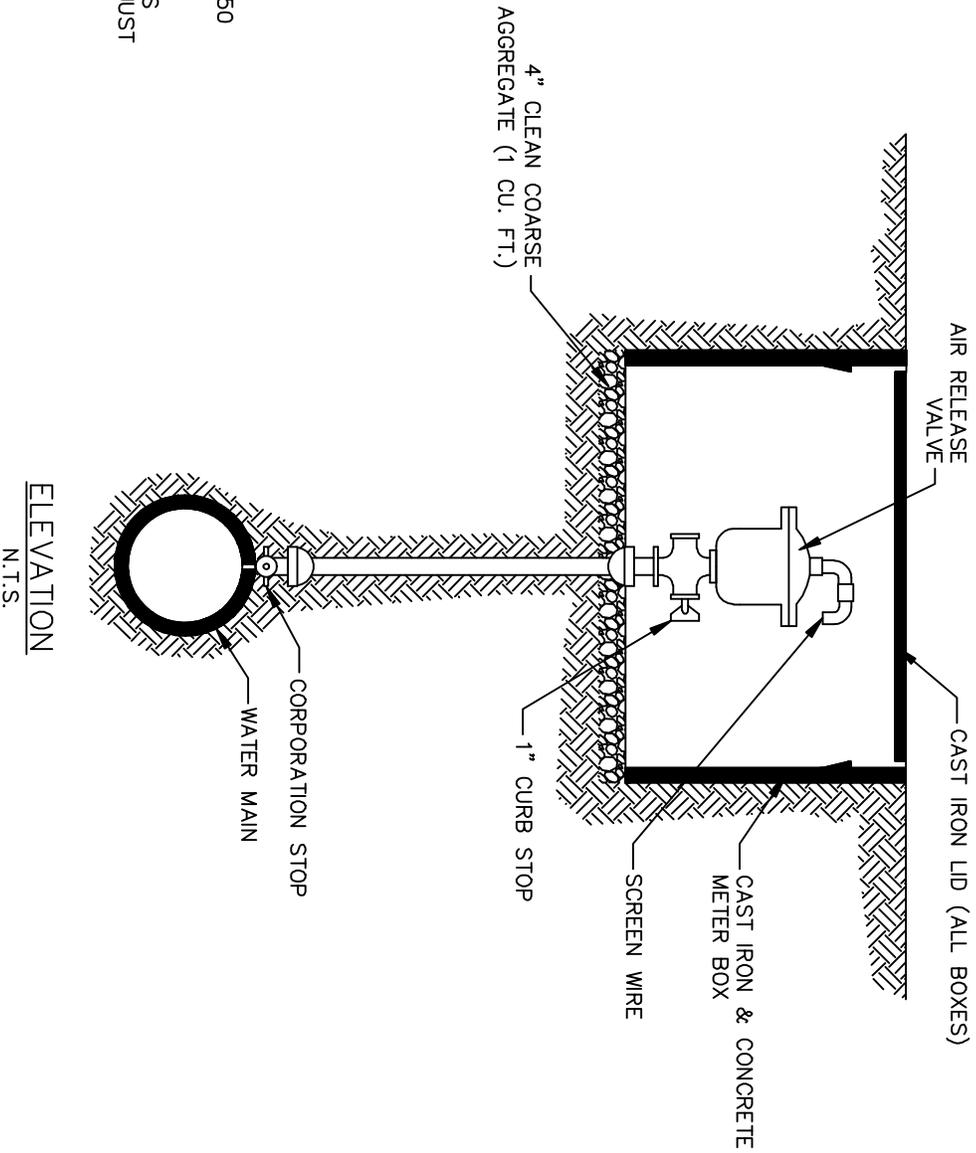

ELEVATION
N.T.S.

YORK COUNTY ENGINEERING
STANDARDS

WATER AIR RELEASE VALVE
STANDARD DETAIL

STD. NO.	11.06
DATE	10/06