
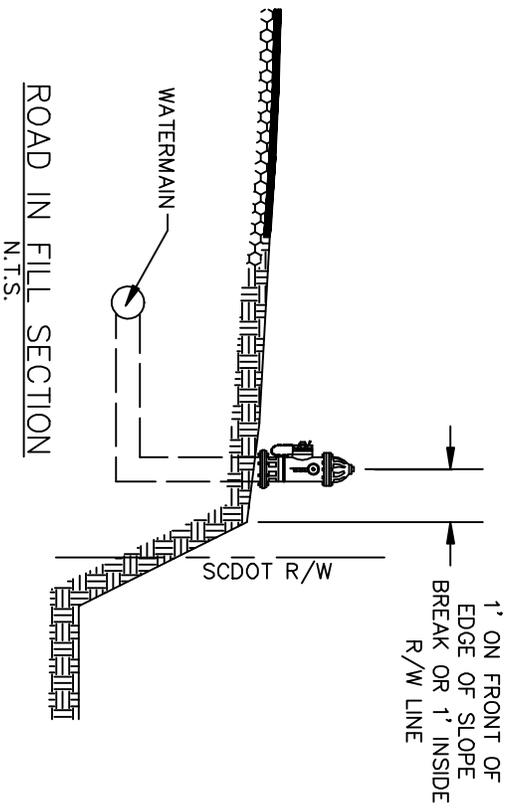
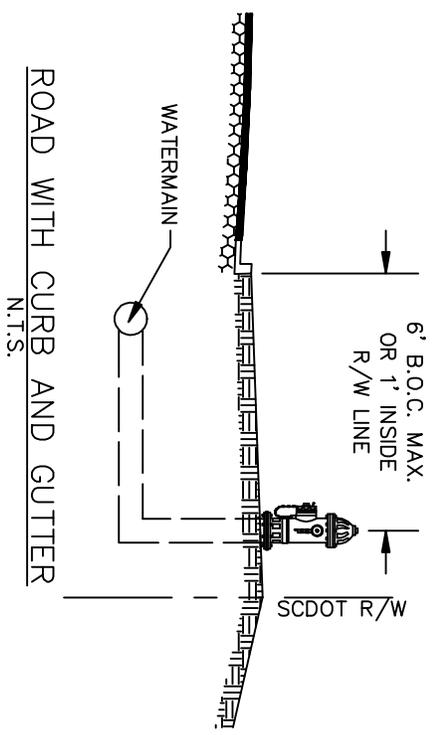
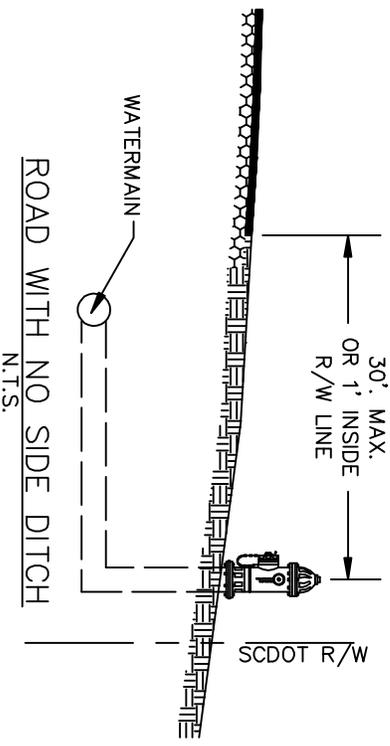


- NOTES:
 1. IN ALL CASES, FIRE HYDRANTS SHALL BE A MINIMUM OF 1' INSIDE ROAD R/W.
 2. MAINLINE VALVE, GUARD VALVE, AND FIRE HYDRANT SHALL NOT BE PLACED IN DITCH.

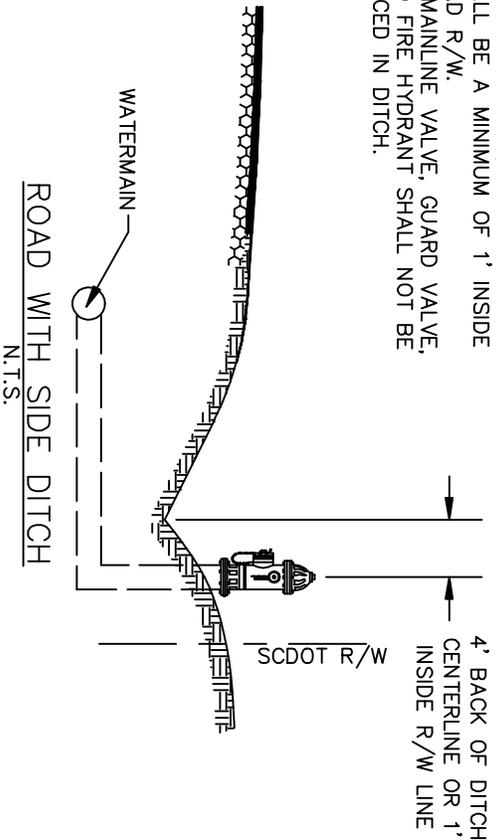

NO.	DATE	DESCRIPTION

REVISIONS

YORK COUNTY ENGINEERING
 STANDARDS

FIRE HYDRANT
 LOCATION WITHIN SCDOT R/W

STD. NO.	11.08
DATE	09/06