


- NOTES:
1. INSTALL CONNECTOR LINE FROM EXISTING BLOW-OFF ASSEMBLY TO NEW MAIN FOR FILLING, TESTING AND STERILIZING NEW MAIN.
  2. CONNECTOR LINE TO BE ASSEMBLED WITH CHECK VALVE AND TO BE OPERATED INDEPENDENT OF EXISTING MAIN.
  3. BLOCKING ON EXISTING LINE NOT TO BE DISTURBED.
  4. FINAL CONNECTION TO EXISTING MAIN TO BE MADE ONLY AFTER TOTAL PROJECT IS ACCEPTED BY THE ENGINEERING DEPARTMENT.
  5. VALVES ON EXISTING SYSTEM TO BE OPERATED BY COUNTY PERSONNEL ONLY.
  6. ONLY ONE CONNECTION WILL BE ALLOWED BETWEEN THE EXISTING SYSTEM AND THE NEW CONSTRUCTION UNTIL TESTING AND DISINFECTION ARE COMPLETE.

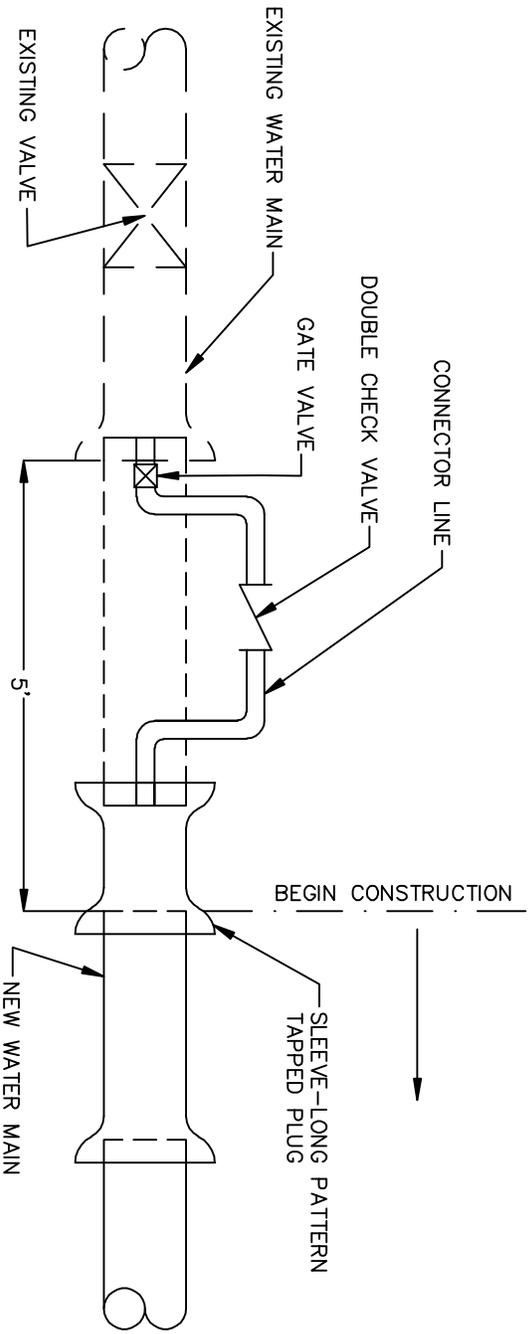

REVISIONS

NO.	DATE	DESCRIPTION

YORK COUNTY ENGINEERING  
STANDARDS

JUMPER CONNECTION  
STANDARD DETAIL

STD. NO.	11.10
DATE	09/06