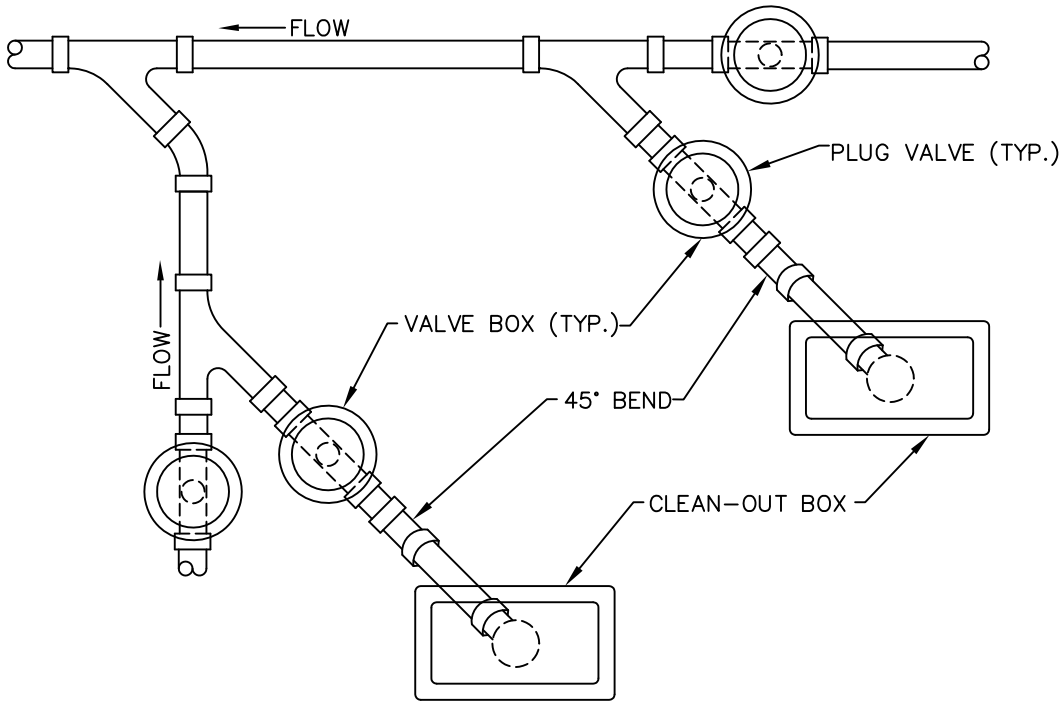

PLAN VIEW
N.T.S.

NOTES:
1. DELETE CLEAN-OUTS UNLESS SHOWN ON SEWER PLAN SHEET OR REQUIRED AT HIGH POINTS FOR AIR RELEASE.
2. PIPE MATERIAL TO BE IPS PRESSURE-RATED PVC PIPE SDR 13.5, PC315

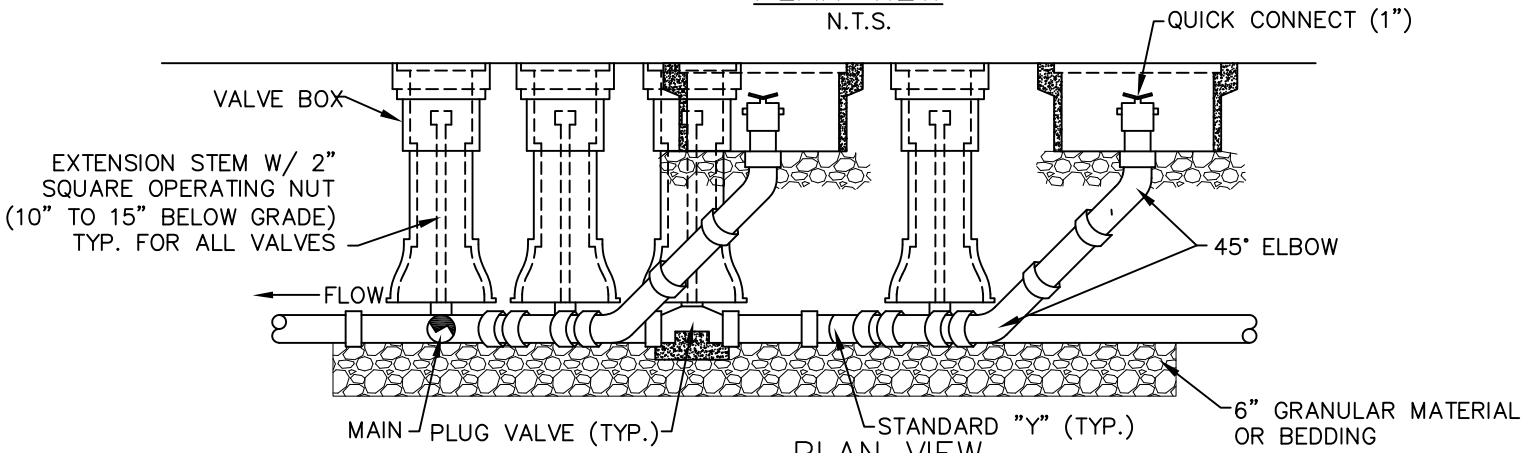

PLAN VIEW
N.T.S.

REVISIONS

NO.	DATE	DESCRIPTION
1	3/12	ADDED NOTE 2

YORK COUNTY ENGINEERING STANDARDS

LOW-PRESSURE SEWER
VALVE AT INTERSECTION

STD. NO. 14.01
DATE 10/06