


- NOTES:**
1. CONFIGURATION MAY VARY DEPENDING ON PRIVATE PLUMBING CONTRACTOR.
 2. ALL PRIVATE PLUMBING SHALL BE IN ACCORDANCE WITH SOUTH CAROLINA BUILDING CODE.
 3. THE PUMP BASIN COVER MUST BE A MINIMUM OF 2' ABOVE THE HIGH WATER MARK FOR LAKE WYLIE.

NO.	DATE	DESCRIPTION
1	3/10	REVISED DRAWING
2	3/12	REVISED NOTES

- REVISIONS**
4. THE GRINDER PUMP MUST BE SECURED TO THE BASE TO PREVENT A FLOAT-AWAY CONDITION.

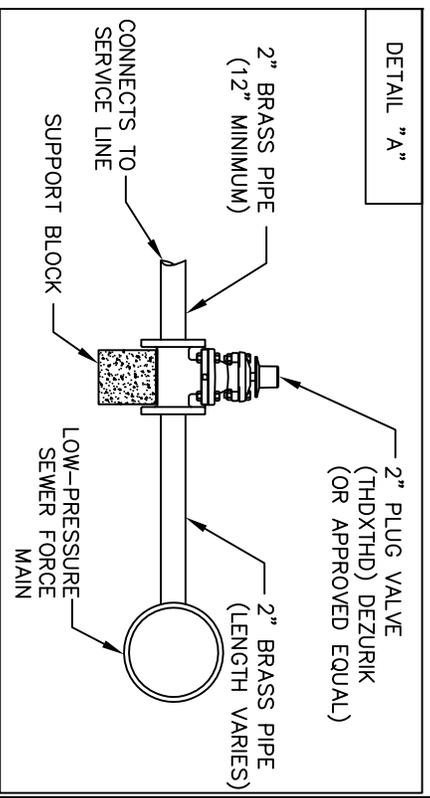

**YORK COUNTY
ENGINEERING
STANDARDS**

**LOW-PRESSURE SEWER
INDIVIDUAL GRINDER PUMP SYSTEM TYPICAL**

STD. NO.	14.06
DATE	10/06