



PLAN VIEW  
N.T.S.



SECTION VIEW  
N.T.S.

SIZE OF D.I. CARRIER PIPE	SIZE OF STEEL CASING PIPE	COATED PIPE MIN. WALL THK.	PIPE CLASS
2"	6"	0.250	STANDARD
4"	12"	0.250	SCHED.20
6"	14"	0.250	SCHED.20
8"	16"	0.250	SCHED.10
10"	18"	0.250	SCHED.10
12"	22"	0.250	SCHED.10
14"	24"	0.250	SCHED.10
16"	26"	0.250	SCHED.10

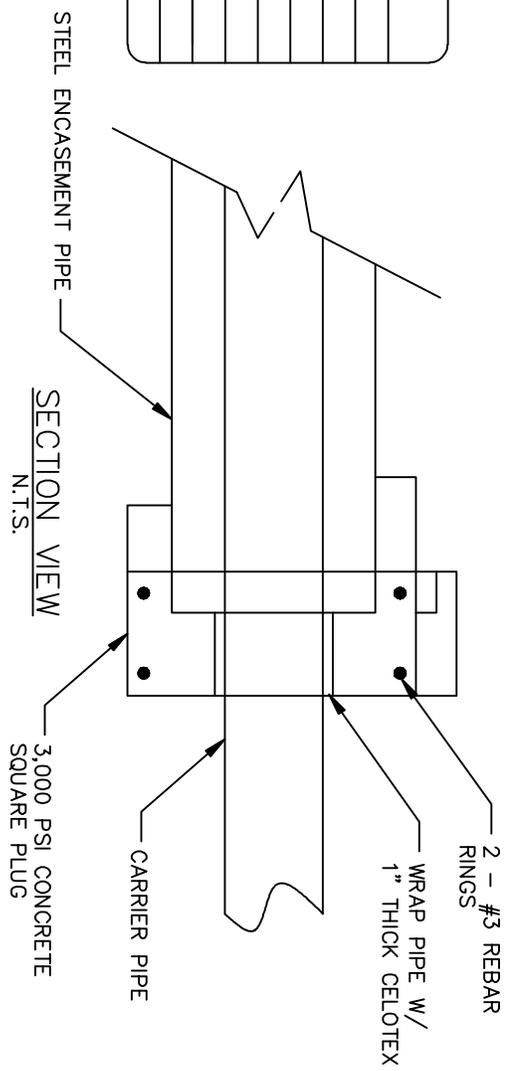

NOTE:  
CASING TO REMAIN AFTER INSTALLATION. NON-COATED AND SAID CASING IS NOT CATHODICALLY PROTECTED, THE WALL THICKNESS SHALL BE INCREASED TO THE NEAREST STANDARD SIZE WHICH IS A MINIMUM OF 0.063" GREATER THAN THE THICKNESS SHOWN EXCEPT FOR DIAMETERS UNDER 12 3/4".

REVISIONS

NO.	DATE	DESCRIPTION
1	3/09	REVISED MIN. WALL THICKNESS

YORK COUNTY ENGINEERING  
STANDARDS

BORING ENCASEMENT  
STANDARD DETAIL

STD. NO.	15.06
DATE	02/08