

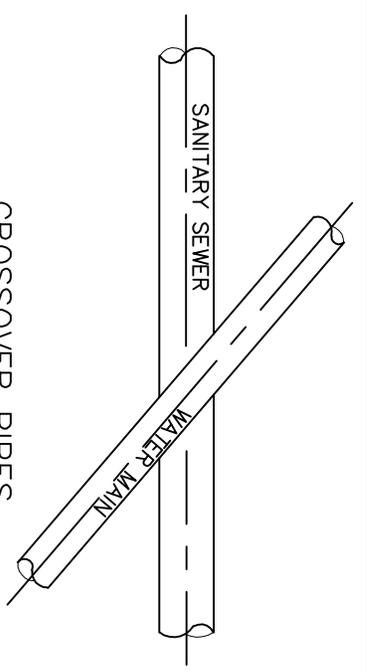


PARALLEL PIPES
N.T.S.


NOTES:
1. WHEN LATERAL SEPARATION IS 10' OR GREATER, NO VERTICAL CLEARANCE IS REQUIRED.

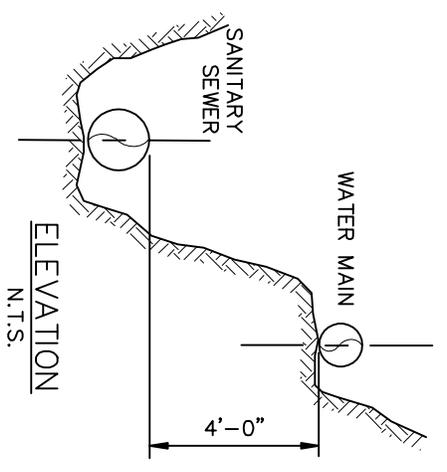

CROSSOVER PIPES
N.T.S.

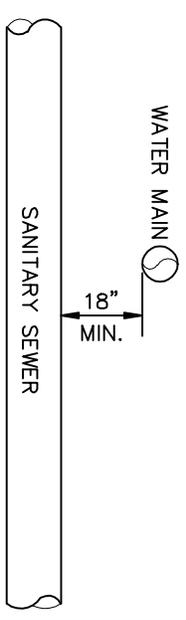

MINIMUM VERTICAL CLEARANCE
N.T.S.

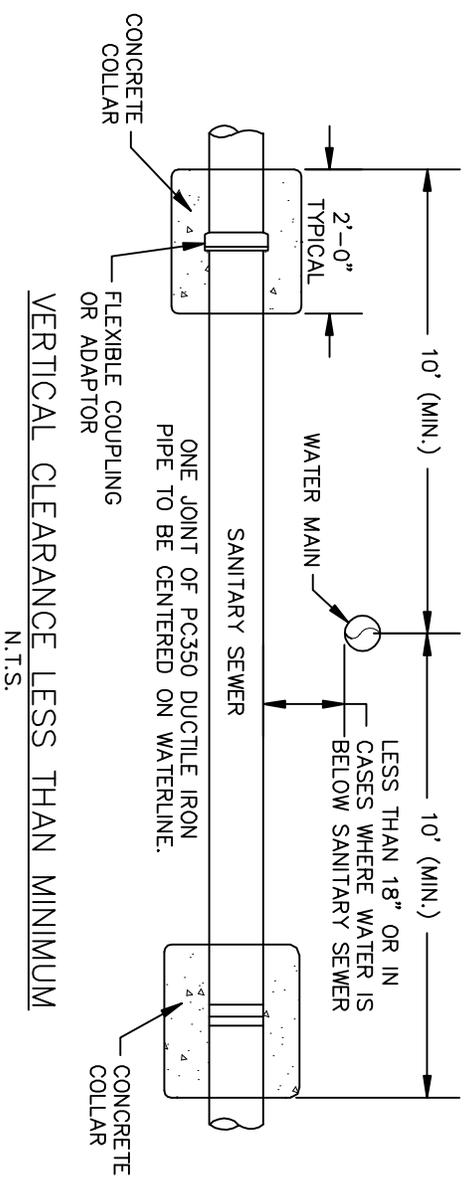

NO.	DATE	DESCRIPTION

REVISIONS

YORK COUNTY ENGINEERING
STANDARDS

PIPE SEPARATION REQUIREMENTS
FOR WATER MAINS AND SANITARY SEWER LINES

STD. NO.	15.07
DATE	10/06