


REINFORCEMENT DETAIL
N.T.S.

- NOTES:
1. MINIMUM THICKNESS OF FOOTING ABOVE ROCK TO BE SAME AS BASE THICKNESS OF PIER.
 2. MAT STEEL FOR FOOTING SHALL BE TIED TO DOWELS.
 3. CONCRETE SHALL BE 3600 PSI.

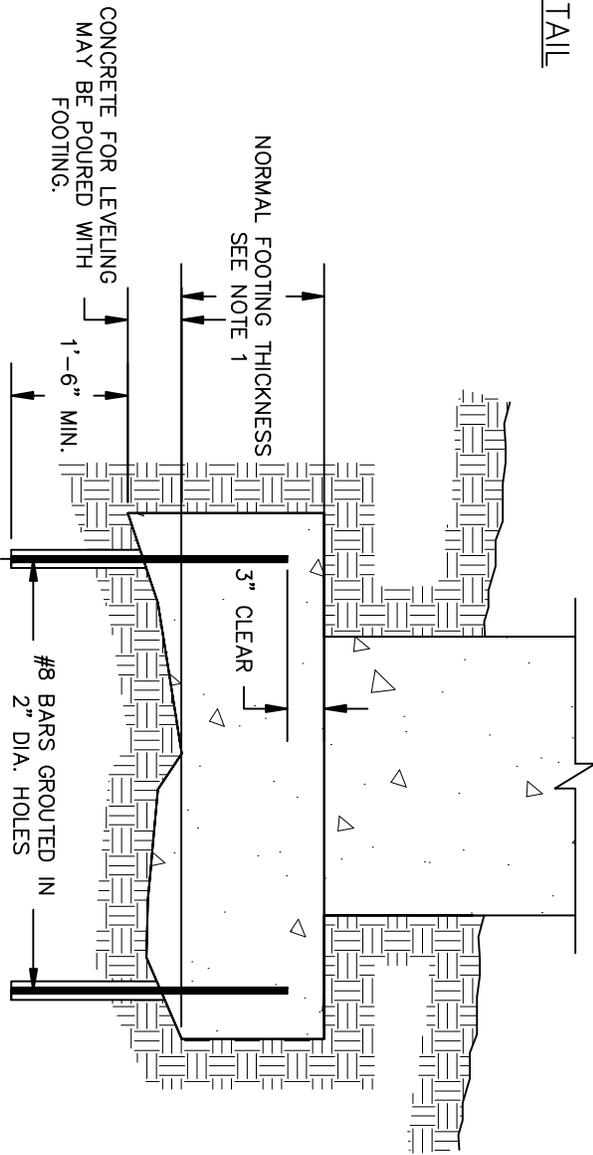

SECTION VIEW
N.T.S.

REVISIONS	
NO.	DESCRIPTION

YORK COUNTY ENGINEERING
STANDARDS

PIER FOOTING
ON ROCK

STD. NO.	15.10
DATE	09/06